



# X7-WIFI

- **Commercial Grade Wi-Fi Thermostat**
- **Gas/Electric to 2H/2C, Heat Pump to 3H/2C**
- **Humidity Sensing and Control**
- **CO<sub>2</sub> Sensing and Control Ready**
- **Advanced Remote Sensor Bus**
- **Two Configurable**
- **Full Color Touchscreen**
- **7 Day Programmable ~ 4 Events/Day**
- **80 Additional Event Schedules**
- **BACnet/IP and Modbus TCP/IP Included**

## GENERAL DESCRIPTION:

## Complete Stand-Alone Solution

The X7-WIFI is a Wi-Fi color touchscreen thermostat with an advanced remote sensor bus, designed for new or replacement commercial and residential applications. Use the X7 for either conventional or heat pump applications (Gas/Elect 2H/2C, HP 3H/2C), along with humidification, fresh air damper, IAQ controls, and more. The X7 has an accessory slot for a revolutionary CO<sub>2</sub> sensor that requires no field calibration for five (5) years. The X7 delivers a near-effortless setup of your daily schedules (4 events per day) and up to 80 Additional Events (40 Special and 40 Calendar Events). The unique scheduling structure also supports the powerful features of adjustable temporary override times and temperature ranges, occupied and unoccupied events, keypad lockout, and many more features. The X7-WIFI also includes full Modbus TCP/IP and BACnet/IP support over Wi-Fi, directly on the thermostat.

The X7-WIFI is designed to operate with our CloudConnect™ Online Management software or, for maximum security, behind your firewall using DirectConnect™ or our PCConnect™ Software. Since all HVAC functions are stored in the thermostat, the X7 will continue to operate even during network outages, allowing you to maintain your energy savings. For ultimate control over energy usage, the X7 offers a digital lockout that can permit limited temperature overrides based on your requirements. Our onboard data collection allows for historical review, sub-metering, and run-time reporting.

## STANDARD FEATURES:

## CloudConnect™ & CloudManager™ Available

### Energy Savings

- Efficient Equipment Restart™ randomizes equipment starts to minimize multiple units turning on simultaneously when there are multiple NetX thermostats at the location
- Random Restart on power up staggers restart of HVAC system after a power outage to minimize peak inrush current
- Adaptive Recovery for Schedules allows system to achieve desired setpoint at the beginning of the schedule

### Monitoring

- 12 Remote Sensors: up to 6 indoor, 1 humidity, 1 outdoor, 1 water leak sensor, and up to 3 auxiliary sensors for monitoring items such as supply air, return air, walk-in refrigerators and freezers, etc.
- Accessory Port for CO<sub>2</sub> Sensor
- 2 Digital Inputs for Fault Conditions, including Condensate and Equipment Faults
- Occupancy Sensor Input
- On-board Data Logging with Sub-Metering Support

### Connectivity

- CloudConnect™ Internet-Based Cloud Service
- PCConnect™ Software Local Network & Port Forwarded Access
- DirectConnect™ Integrated Web Server
- Integrated NetX™ API, Supports 3rd Party Apps
- BACnet/IP and Modbus TCP/IP Embedded

### Facility Management

- 4 independent schedules per day
- 80 Additional Schedules (40 Special and 40 Calendar Events)
- Commercial Lockout with Programmable Temporary Override Time and Temp Adjustment
- Email & Text Message Alerting
- Alerts include Hi/Lo Temps for Indoor, Outdoor, Supply, Return, and Aux Temps, Inefficient Equipment Runs, Change Filter Notifications, and Two Digital Inputs: 19 Alerts in All

### General

- Color Selectable Touchscreen Display, Black or White Case
- Modes: Heat, Cool, Automatic Changeover
- Integrated Humidity Sensor & Humidification and Dehumidification Control
- Fan Selector for Automatic and Manual Operation; Programmable Recirculation Fan
- Relay 1 & Relay 2 Flexible Control
  - Humidification and Dehumidification Control
  - Fresh-Air Damper Control
  - IAQ Equipment Control Control
  - Auxiliary General Purpose Relays with Scheduling
- Integrated Weather with Current Conditions and 7-Day Forecasts




**Made in USA**

## SPECIFICATIONS:

|                                    |  |
|------------------------------------|--|
| <b>Rated Voltage:</b>              | 20V to 30VAC, 24VAC nominal  |
| <b>Rated A.C. / D.C. Current:</b>  | 0.05 to 0.75 AC / 0.0 to 0.75 DC Amp continuous, per output, surges to 3 Amps maximum  |
| <b>Temperature Control Range:</b>  | <b>Heating:</b> 38 to 88°F (6 to 30°C) in 1° steps <b>Cooling:</b> 60 to 108°F (16 to 40°C) in 1° steps  |
| <b>Thermostat Sensing Range:</b>   | 20 to 124°F (0 to 48°C) <b>Control Accuracy:</b> ±1°F @ 68°F (0.5°C @ 20°C)  |
| <b>Minimum Deadband:</b>           | 2°F (1°C)  |
| <b>Humidity Sensing:</b>           | <b>Range:</b> 0% - 100% RH <b>Accuracy:</b> ±3% From 10% - 90%   |
| <b>Humidity Control Range:</b>     | <b>Humidify:</b> 10% to 60%RH in 5%RH steps <b>Dehumidify:</b> 35% to 75%RH in 5%RH steps  |
| <b>Dimensions:</b>                 | 5.1"H x 4.7"W x 1.15"D (128mm x 119mm x 29mm)  |
| <b>Equipment Terminations:</b>     | R - 24V switching voltage, W1 - Heat1 or Aux/Emer Heat, G - Fan, Y1-Compressor1, Y2 - Compressor2, O/W2 - Heat2 or Rev. Valve in Cooling, B - Rev. Valve in Heating, |
| <b>Aux Relay Terminations:</b>     | K/H/D – Humidify / Dehumidify / Relay 1 Schedule / Damper / IAQ , K2 – Relay 2 Schedule / Damper / IAQ   |
| <b>Power Terminations:</b>         | 24V(c) - Power Return, 24V - Separate Power (24VAC/DC) requires jumper removal   |
| <b>Input Terminations:</b>         | LED1 (Filter Icon Selectable), LED2 (Fault Icon Selectable), CLK1 ( + ), CLK2 ( - ) (Occupancy)  |
| <b>Remote Sensor Terminations:</b> | RS+V - Power, RS2 - Return, RS1 - Data   |
| <b>Wireless Radio:</b>             | 2.4GHz 802.11b/g/n, Security: Open, WEP, WPA-PSK, WPA2-PSK   |
| <b>Accessory Port:</b>             | SIM port for NetX CO <sub>2</sub>  |
| <b>Protocols:</b>                  | http, native NetX API, BACnet/IP and Modbus TCP/IP over Wi-Fi  |

## WIRING DIAGRAMS:

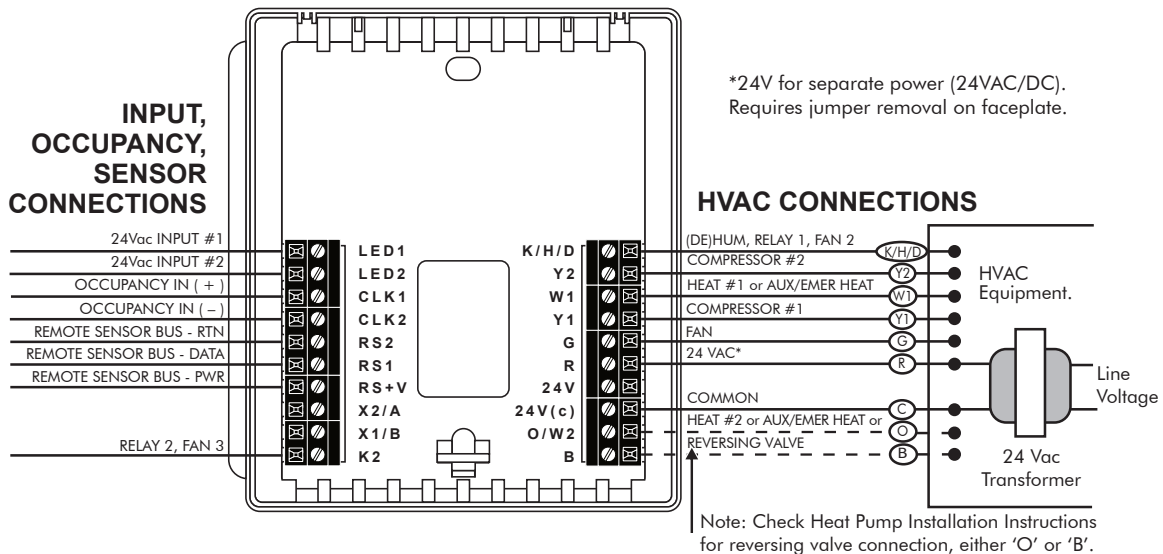

## TERMINAL FUNCTIONS

|   |   |
|---|---|
| <b>LED1</b> 24Vac Input #1 for Filter or other Alert            | <b>K/H/D</b> Humidification or Dehumidification, Aux. Relay 1, or FAN 2   |
| <b>LED2</b> 24Vac Input #2 for Condensate, Fault or other Alert | <b>Y2</b> Energizes compressor for second stage cooling, or for heat pumps, either second stage heating or cooling      |
| <b>CLK1</b> For use with External Occupancy Sensor ( + )        | <b>W1</b> Energizes heater for first stage heating, or for heat pumps, aux/emmer heat                                   |
| <b>CLK2</b> For use with External Occupancy Sensor ( - )        | <b>Y1</b> Energizes compressor for first stage cooling, or for heat pumps, either first stage heating or cooling        |
| <b>RS2</b> Remote Sensor Bus (Power Return)                     | <b>G</b> Energizes fan circuit with a call for heating or cooling   |
| <b>RS1</b> Remote Sensor Bus (Data)                             | <b>R</b> Independent Switching Voltage from HVAC equip  |
| <b>RS+V</b> Remote Sensor Bus (Power)                           | <b>24V</b> 24Vac  |
| <b>X2/A</b> N/A   | <b>24V(c)</b> 24Vac Common  |
| <b>X1/B</b> N/A   | <b>O/W2</b> Energizes heater for second stage heating, or for heat pumps, energizes the reversing valve in cooling mode |
| <b>K2</b> Programmable Auxiliary Relay 2, FAN 3                 | <b>B</b> Energizes the reversing valve in heating mode  |